

4 SITE PLAN
SCALE: 1" = 20'-0"




2 EXISTING ANTENNA LOCATION
SCALE: NOT TO SCALE

NOTES:

1. PROVIDE NEW ANTENNA AND ANTENNA CABLE MOUNTED AT THE TOP OF THE EXISTING MAST. THE EXISTING YAGI ANTENNA AND CABLE SHALL BE LOWERED TO THE BOTTOM OF THE MAST AND THEN REMOVED AFTER SUCCESSFUL INSTALLATION OF THE NEW RTU, OIT, RADIO AND ANTENNA CABLE.
2. REMOVE EXISTING MOSCAD RTU PANELS AND APPURTENANCES.
3. EXISTING TELOG PANEL TO REMAIN.
4. CONTROL PANEL HAS BEEN RECENTLY UPGRADED. REMOVE EXISTING PLC/OIT AND INSTALL NEW RTU/OIT AND RADIO IN THE EXISTING CONTROL PANEL.

CONDUIT/CABLE SCHEDULE	
A	ANTENNA CABLE
B	NOT USED
C	NOT USED
D	NOT USED
E	NOT USED

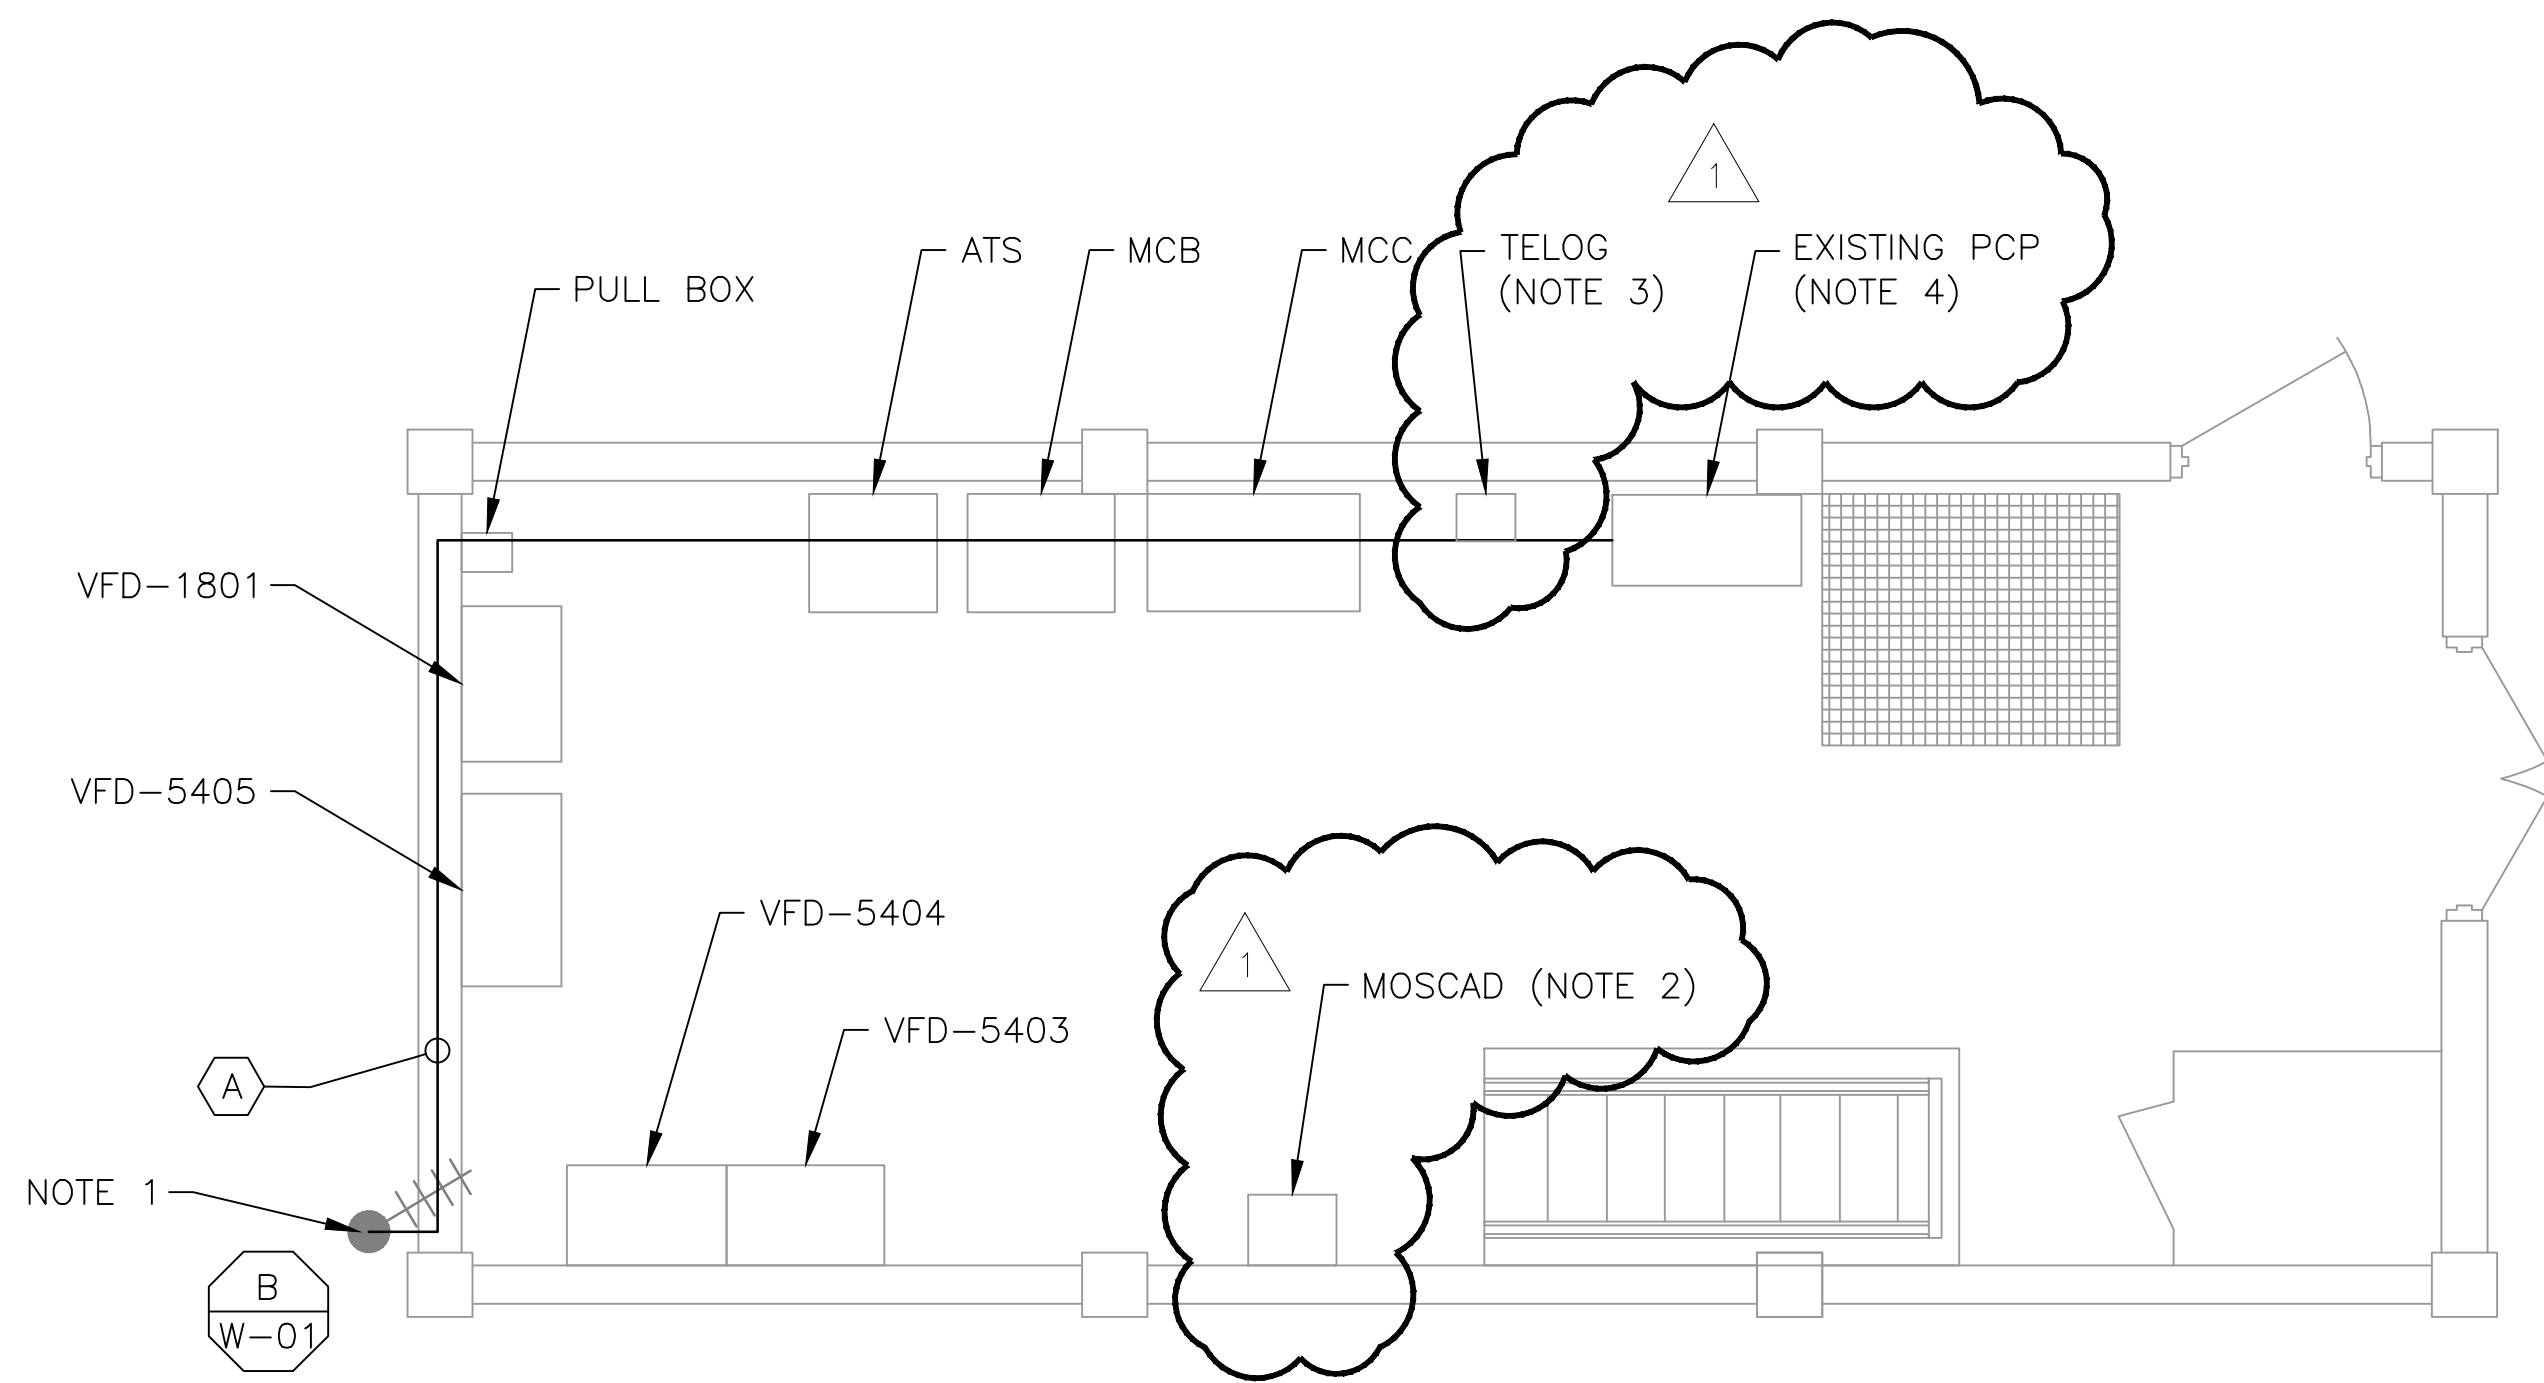

1 ELECTRICAL ROOM FLOOR PLAN
SCALE: NOT TO SCALE




3 MOSCAD PANEL LOCATION
SCALE: NOT TO SCALE




ISSUE	DATE	DESCRIPTION
1	MAR 2015	CONFORMED DWG REVISED PER ADDENDUM 2
0	DEC 2014	BID

PROJECT MANAGER:	D. FOOTE
DESIGNED BY:	B. BUTLER
DRAWN BY:	G. BUI
PROJECT NUMBER:	8582

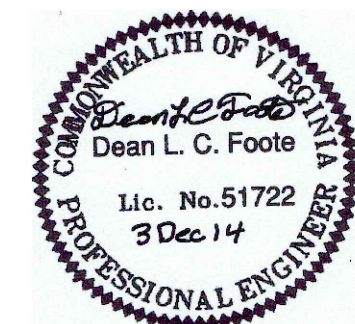

HAMPTON ROADS SANITATION DISTRICT
VIRGINIA BEACH, VIRGINIA

INTERCEPTOR SYSTEMS PUMP STATION
CONTROL AND SCADA



FILENAME	05127ESS57.DWG
SCALE	AS NOTED

STATE ST
GRAVITY LIFT STATION
NO 127
SITE PLAN

DRAWING NUMBER	ES-57
SHEET	141 OF 256