


**5 SITE PLAN**  
SCALE: 1" = 20'-0"



**1 ROOM PLAN**  
SCALE: 1/8" = 1'-0"

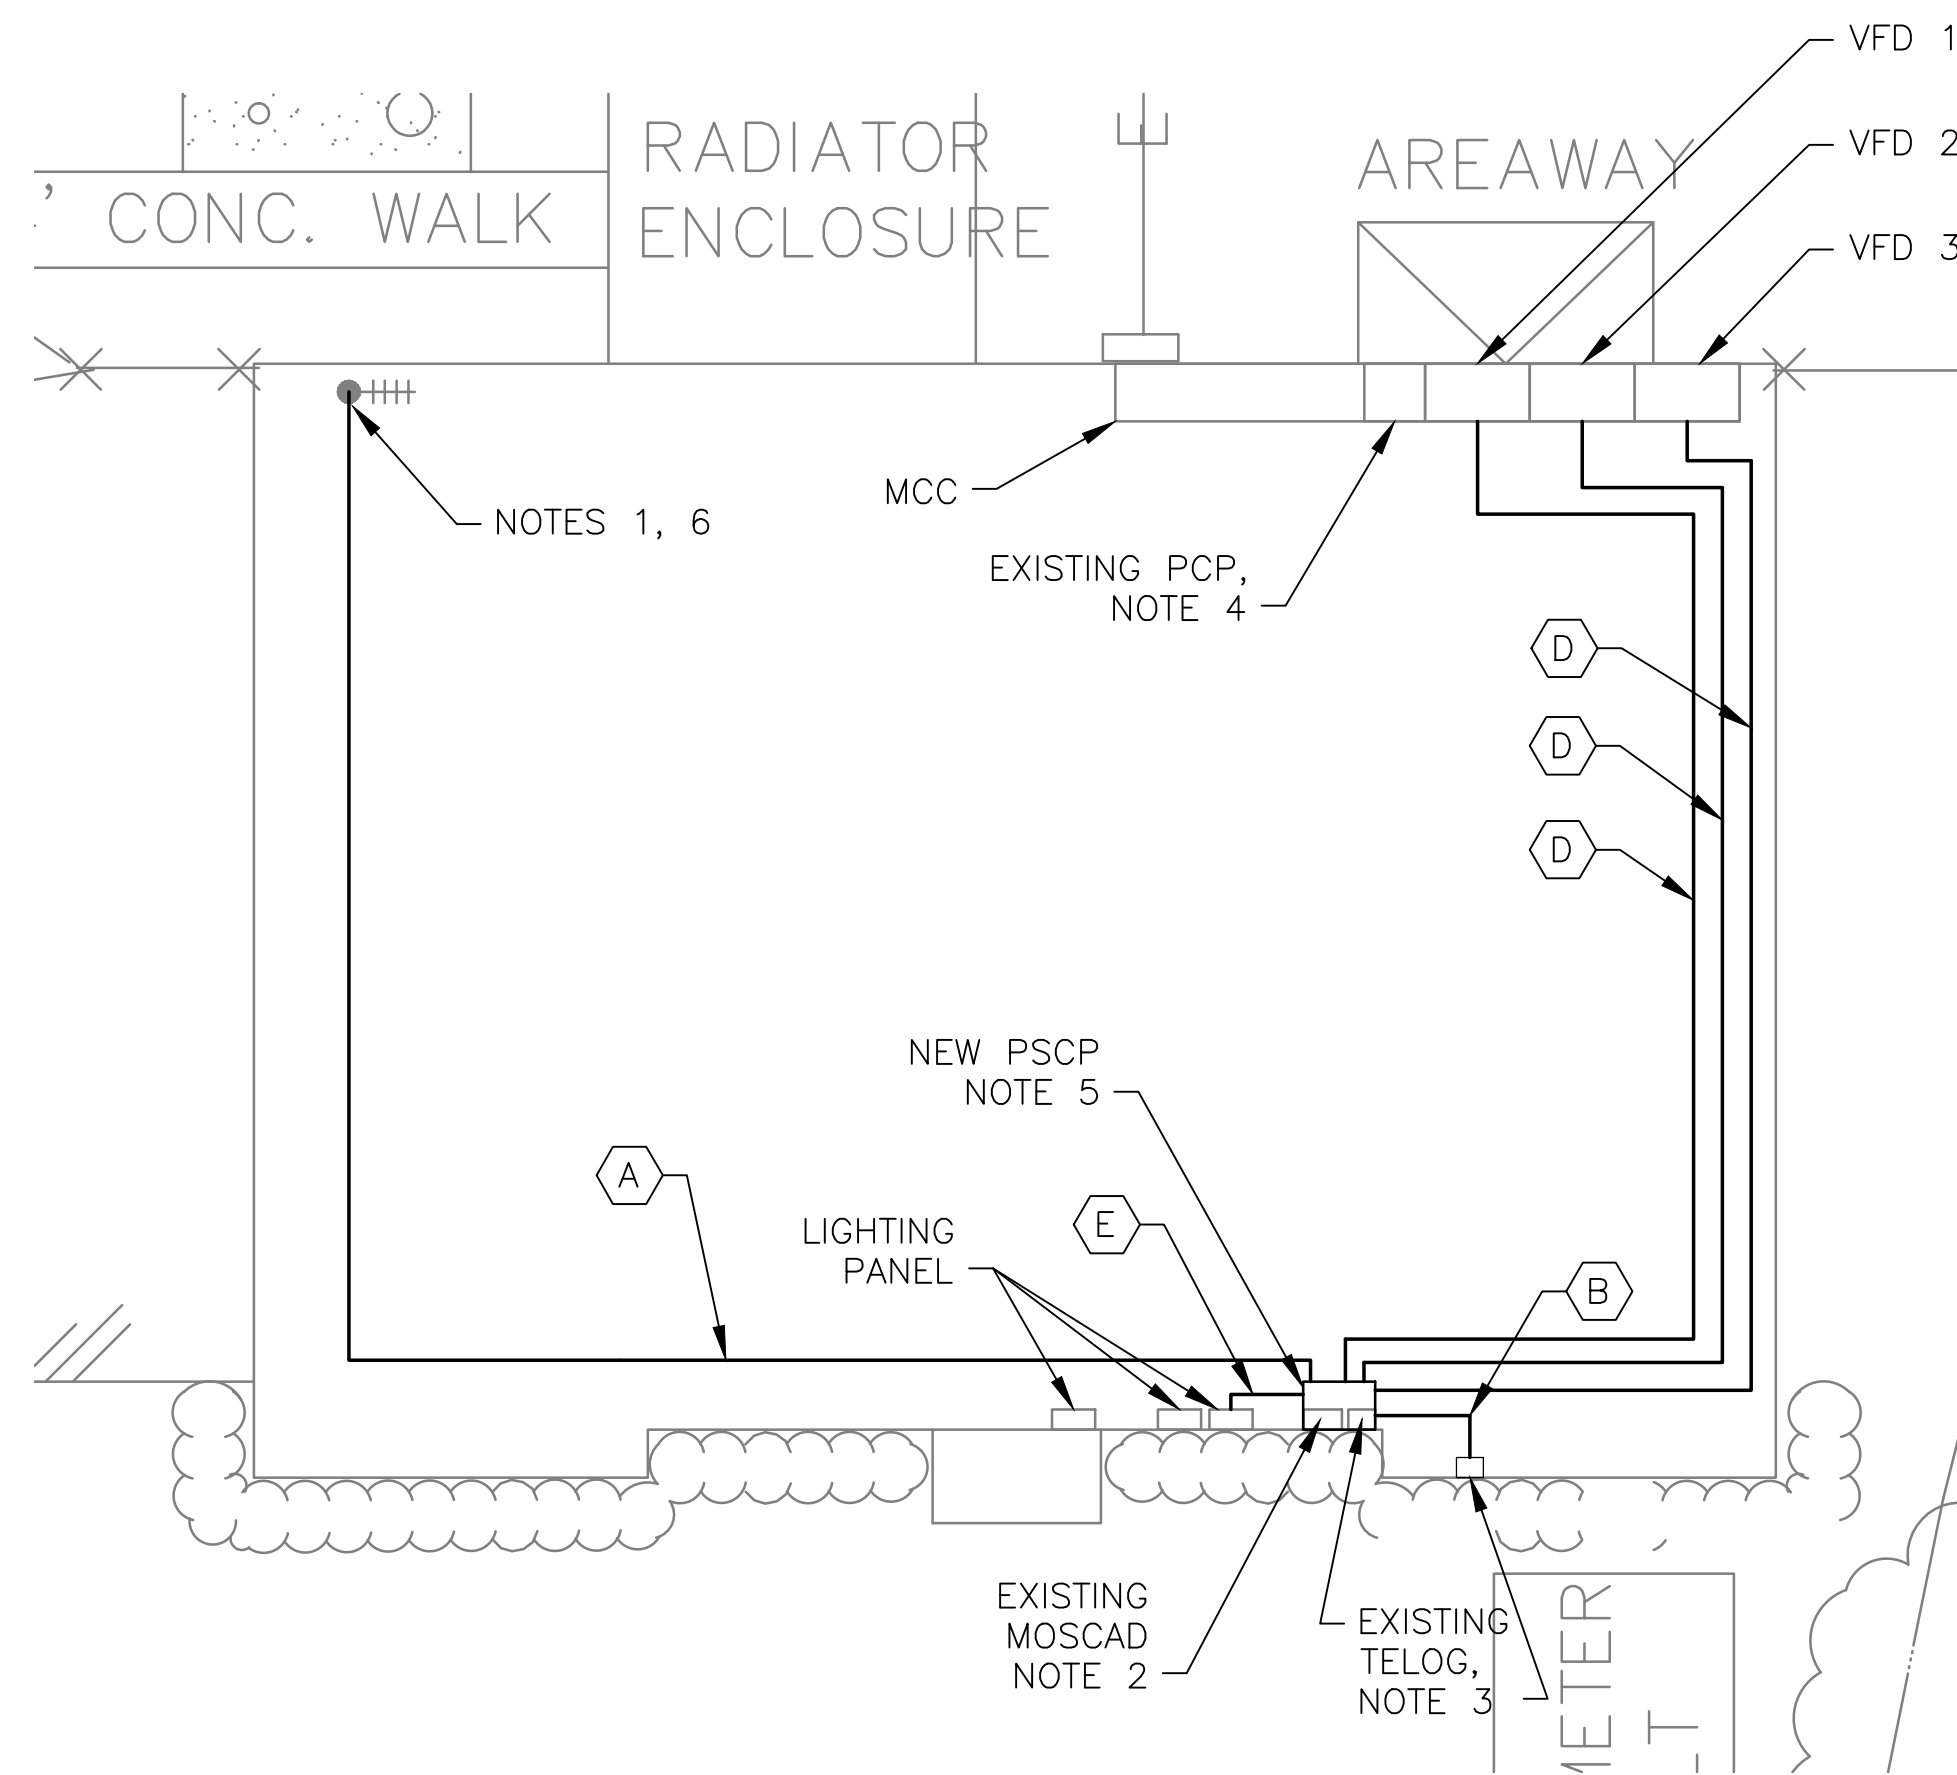

**2 EXISTING ANTENNA LOCATION**  
SCALE: NOT TO SCALE

**NOTES:**

1. EXISTING YAGI ANTENNA AND CABLE TO BE REMOVED AFTER SUCCESSFUL INSTALLATION OF THE NEW PUMP STATION CONTROL PANEL (PSCP).
2. EXISTING MOSCAD PANEL AND TERMINATION PANEL TO BE TEMPORARILY RELOCATED; THEN REMOVED FROM THE SITE AFTER INSTALLATION AND TESTING OF THE NEW PSCP. REFER TO THE I/O LIST FOR EXISTING MOSCAD ANALOG AND DIGITAL I/O SIGNALS WHICH WILL BE RE-TERMINATED WITHIN THE NEW PSCP.
3. EXISTING TELOG PANEL TO BE RELOCATED AND MOUNTED TO THE SPACE ADJACENT TO THE NEW PSCP. EXACT LOCATION TO BE COORDINATED WITH HRSD. REMOVE EXISTING ANALOG AND DIGITAL INPUTS BETWEEN MOSCAD UNIT AND TELOG UNIT. REPLACE THESE SIGNALS WITH IDENTICAL SIGNALS ORIGINATING FROM THE NEW PSCP.
4. EXISTING PUMP CONTROL PANEL TO REMAIN. REMOVE EXISTING PLC'S, RELAYS, AND CONTROL EQUIPMENT AFTER INSTALLATION AND TESTING OF THE NEW PSCP.
5. REFER TO DRAWING G-13 FOR DETAILS OF THE CONSTRUCTION PHASING REQUIREMENTS FOR THE NEW PSCP.
6. MOVE EXISTING ANTENNA DOWN ON MAST AND INSTALL NEW ANTENNA ON TOP OF MAST. INSTALL NEW ANTENNA CABLE.
7. REFER TO DRAWING G-14 FOR PANEL LAYOUT.

**CONDUIT/CABLE SCHEDULE**

A	ANTENNA CABLE
B	2 #12, 1 #12 GND IN 3/4" C
C	12 #14 IN 3/4" C
D	7 STP IN 1-1/2" C
E	NOT USED
F	16 #14 IN 3/4" C
G	3 STP IN 3/4" C
H	2 #12, 1 #12 GND IN 3/4" C
I	NOT USED



**3 EXISTING MOSCAD PANEL**  
SCALE: NOT TO SCALE




**4 EXISTING CONTROL PANEL**  
SCALE: NOT TO SCALE



ISSUE	DATE	DESCRIPTION
1	MAR 27 2015	CONFORMED DRAWINGS
0	DEC 2014	BID


PROJECT MANAGER:	D. FOOTE
DESIGNED BY:	B. BUTLER
DRAWN BY:	G. BUI
PROJECT NUMBER:	8582

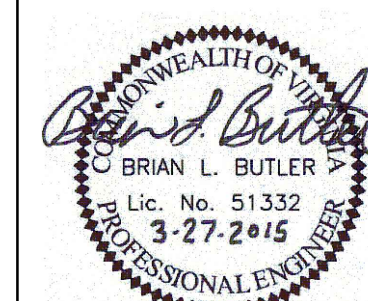

**HAMPTON ROADS SANITATION DISTRICT**  
**VIRGINIA BEACH, VIRGINIA**

**INTERCEPTOR SYSTEMS PUMP STATION**  
**CONTROL AND SCADA**

**KEMPSVILLE**  
**PRESSURE REDUCING STATION**  
**NO 151**  
**SITE PLAN**



FILENAME	05151ES19.DWG
SCALE	AS NOTED

DRAWING NUMBER	ES-19
SHEET	106 OF 256