NOTES:

1. CONTROL PANEL HAS BEEN RECENTLY UPGRADED AND NEW RTU HAS ALREADY BEEN INSTALLED. REMOVE EXISTING OIT AND INSTALL NEW OIT AND RADIO IN EXISTING CONTROL PANEL.
2. REMOVE EXISTING MOSCAD PANEL AND APPURTENANCES.
3. PROVIDE NEW ANTENNA, MAST AND ANTENNA CABLE. THE EXISTING YAGI ANTENNA AND CABLE SHALL BE REMOVED AFTER SUCCESSFUL REPROGRAMMING OF THE RTU AND INSTALLATION OF THE NEW OIT, RADIO AND ANTENNA CABLE.
4. REPROGRAM THE EXISTING RTU USING THE NEW STANDARD FUNCTION BLOCKS.

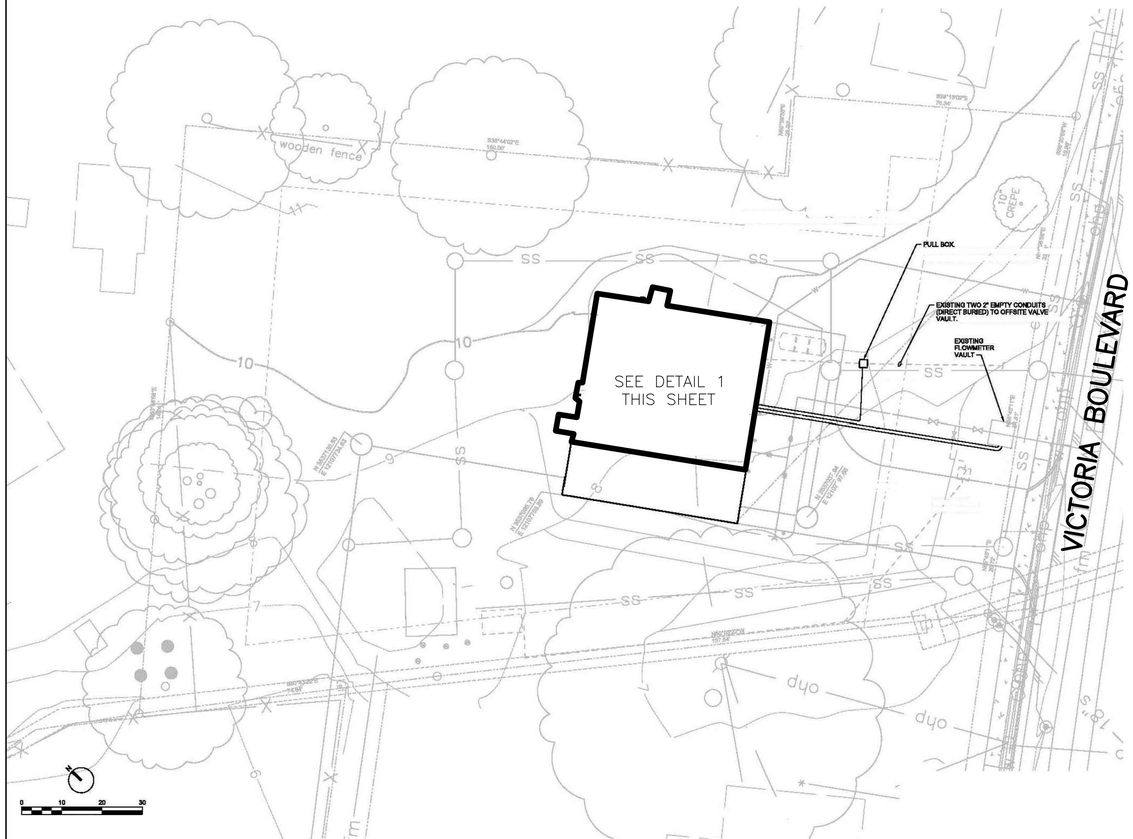

2 SITE PLAN
SCALE: AS NOTED

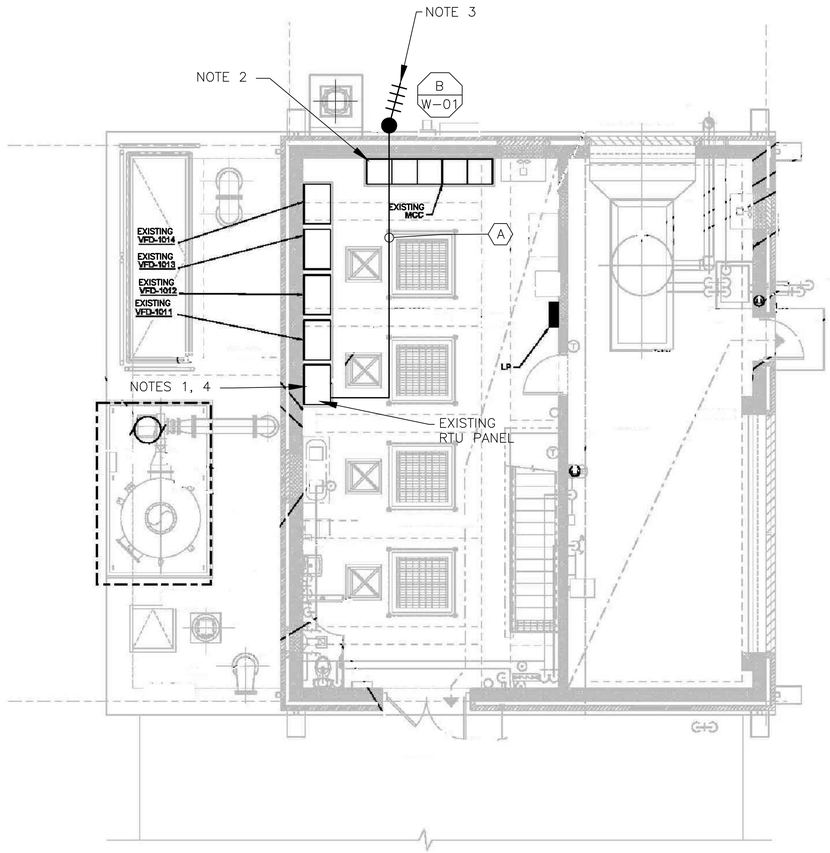

1 FLOOR PLAN
SCALE: 3/16" = 1'-0"

CONDUIT/CABLE SCHEDULE	
A	ANTENNA CABLE
B	NOT USED
C	NOT USED
D	NOT USED
E	NOT USED

Westin

ISSUE	DATE	DESCRIPTION
1	MAR 27 2015	CONFORMED DRAWINGS
0	DEC 2014	BID

PROJECT MANAGER:	D. FOOTE
DESIGNED BY:	B. BUTLER
DRAWN BY:	G. BUI
PROJECT NUMBER	8582

COMMONWEALTH OF VIRGINIA
BRIAN L. BUTLER
Lic. No. 51332
3-27-2015
PROFESSIONAL ENGINEER

HAMPTON ROADS SANITATION DISTRICT
VIRGINIA BEACH, VIRGINIA

INTERCEPTOR SYSTEMS PUMP STATION CONTROL AND SCADA

VICTORIA BOULEVARD GRAVITY LIFT STATION SITE PLAN

0 1" 2"

FILENAME	04119EN50.DWG
SCALE	AS NOTED
DRAWING NUMBER	EN-50
SHEET	94 OF 256